

2404 2408

MODELS



Controller/Programmer Specification Sheet

- **High stability control**
- **Up to twenty programs**
- **16 segments**
- **Heating and cooling**
- **Customisable operation**
- **Heater current display**
- **Multiple alarms on a single output**
- **DC retransmission**
- **Digital communications**
 - **Modbus RTU**
 - **Profibus DP network**
 - **DeviceNet® network**

The 2404/2408 is a versatile, high stability temperature or process controller, with self and adaptive tuning, in 1/4 DIN and 1/8 DIN sizes. It comes with a standard 8 segment setpoint programmer, with options for one, four or twenty programs of 16 segments each.

It has a modular hardware construction which accommodates a wide range of plug-in modules. It will accept up to three I/O modules and two communication modules. Two digital inputs and an optional alarm relay are included as part of the fixed hardware build. The hardware is configurable for heating, cooling, alarms and other functions. A transmitter power supply option is available, as is a 5 or 10V transducer supply option. The 2404/2408 is fully configurable on-site.

The 16 segment programmer can have up to 8 programmable outputs which can be set in each segment to trigger external events. The two digital inputs can be used to run, hold and reset the program. Parallel operation of several programmers can be performed with synchronisation chosen at the end of any desired segments.

Precise control

An advanced PID control algorithm gives stable 'Straight-line' control of the process. A one-shot tuner is provided to set up the initial PID values and to calculate the overshoot inhibition parameters. In addition an adaptive tuner will handle processes with continually changing characteristics. On electrically heated loads, power feedback is used to stabilise the output power and hence the controlled temperature against supply voltage fluctuations. Dedicated cooling algorithms ensure optimum control of fan, water and oil cooled systems.

Universal input

A universal input circuit with an advanced analogue to digital convertor samples the input at 9Hz and continuously corrects it for drift. This gives high stability and rapid response to process changes. High noise immunity is achieved by rejection of 50/60Hz pick-up and other sources of noise. Sensor diagnostics are also provided. The input will accept all standard thermocouples, the Pt100 resistance thermometer and linear millivolts, milliamps or DC volts.

Customisable operation

A custom LED display provides a bright, clear display of the process value and setpoint. Tactile push buttons ensure positive operation. Dedicated buttons provide for auto/manual and program run/hold capabilities. Access to other parameters is simple and easy to understand and can be customised to present only those parameters that need to be viewed or adjusted. All other parameters are locked away under password protection.

Alarms

Up to four alarms can be combined onto a single output. They can be full scale high or low, deviation from setpoint, rate of change or load failure alarms. Alarm messages are flashed on the main display. Alarms can be configured as latching or non-latching and also as 'blocking' type alarms which means they will become active only after they have first entered a safe state.

Digital communications

2404/2408 controllers are available with a wide range of communications options. EIA485 2 wire, EIA232, EIA422 4 wire. Profibus DP or Eurotherm® proprietary PDS communications modules are available, offering Modbus RTU, Profibus DP (24xxf), DeviceNet, Eurotherm Bisynch or PDSIO protocols.

iTools configuration editor


Although 2404/2408 controllers are easily and fully configurable via the front panel, iTools configuration software offers an easy to use PC configuration tool.

iTools has the built-in ability to save or clone instrument configurations ensuring full back up of any engineering effort.



OPC Scope

OPC Scope is a separate utility that allows trending, data logging and Dynamic Data Exchange (DDE). It is an OPC explorer program that can connect to any OPC server that is in the Windows registry.

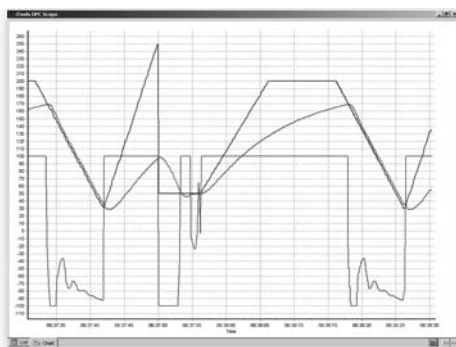

Both data logging and trending are available and the user can trend and view live data, with a scaleable time axis between 1 minute and 1 month. This utility also offers a Historical Review mode and data can be logged onto the PC hard disk, from which it may be retrieved and analysed in an Excel spreadsheet.

SPECIFICATION

General

Environmental performance

| | | |
|--------------------|------------|----------------------------|
| Temperature limits | Operation: | 0 to 55°C |
| | Storage: | -10 to 70°C |
| Humidity limits | Operation: | 5 to 90% RH non condensing |
| | Storage: | 5 to 90% RH non condensing |

| | |
|----------------|---|
| Panel sealing: | IP65 |
| Altitude: | <2000 metres |
| Atmospheres: | Not suitable for use in explosive or corrosive atmosphere |

Electromagnetic compatibility (EMC)

| | |
|-------------------------|------------|
| Emissions and immunity: | BS EN61326 |
|-------------------------|------------|

Suitable for domestic, commercial and light industrial as well as heavy industrial. (Domestic/light (Class B) emissions. Industrial environmental immunity.

Under industrial immunity conditions the instrument will not deviate by more than an additional amount equal to the published tolerance.

Electrical safety

| | |
|------------|--|
| BS EN61010 | Installation cat. II; Pollution degree 2 |
|------------|--|

INSTALLATION CATEGORY II

The rated impulse voltage for equipment on nominal 230V mains is 2500V.

POLLUTION DEGREE 2

Normally, only non-conductive pollution occurs. Occasionally, however, a temporary conductivity caused by condensation shall be expected

Physical

| | | |
|---------------------|-------|-------------------------|
| Panel mounting | 2408: | 1/8 DIN |
| | 2404: | 1/4 DIN |
| Weight | 2408: | 440g max. |
| | 2404: | 670g max. |
| Panel cut-out dims. | 2408: | 45W x 92Hmm (-0.0 +0.8) |
| | 2404: | 92W x 92Hmm (-0.0 +0.8) |
| Panel depth | Both: | 148mm |

Operator interface

| | | |
|--------------------|---|--------------------------|
| Type: | Dual 7 segment LED up to 2 decimal places | |
| Display | 2408: | Upper 12mm Lower 10mm |
| | 2404: | Upper 21mm Lower 10mm |
| Status beacons: | OP1, OP2, SP2, REM | |
| Status indicators: | Auto, manual, run, hold | |
| Access levels: | Operator, full access, Edit, config. Password protected | |

Power requirements

| | |
|-----------------|---|
| Supply voltage: | 85 to 264Vac, 48 to 62 Hz, 2404 16W max. 2408 13W max. 24Vac, -15%, +10% 24Vdc, -15% +20% ±5% ripple voltage |
|-----------------|---|

Inrush current

| | |
|--------------------|---------------------|
| High Voltage (VH): | 30A duration <100µS |
| Low Voltage (VL): | 15A duration <100µS |

Approvals

CE, cUL listed (file E57766), Gost
Suitable for use in Nadcap and
AMS2750D applications under System
Accuracy Test calibration conditions

Communications

| | |
|------------------|---|
| No of ports: | 2 modules can be fitted |
| Slot allocation: | PDSIO remote setpoint or retransmission J comms port |

Serial communications option

| | |
|------------------------|--|
| Protocols: | Modbus RTU Slave Profibus DP (24XXf only) EI-Bisynch (818 style mnemonics) |
| Isolation: | 264Vac, double insulated |
| Transmission standard: | EIA232, EIA485, CAN (DeviceNet), Profibus (24XXf only) |

Main process variable input

| | |
|-----------------------|--|
| Calibration accuracy: | <±0.2% of reading ±1LSD |
| Sample rate: | 9Hz (110ms) |
| Isolation: | 264Vac double insulation |
| Input filter: | Off to 999.9. Default 1.6s |
| Zero offset: | User adjustable over full range |
| User calibration: | 2-point gain & offset |
| Functions: | Includes process input, remote setpoint, power limit |

Thermocouple

| | |
|-----------------------------|--|
| Range: | -100mV to +100mV |
| Types: | K, J, N, R, S, B, L, T, C, PL2, custom |
| Resolution (µV): | <3.3µV @ 1.6s filter time |
| Effective resolution: | 15.9 bits |
| Linearisation accuracy: | <0.2% of reading |
| Cold junction compensation: | >30:1 rejection of ambient change External reference of 0°C, 45°C and 50°C <±1°C at 25°C ambient |

Cold junction accuracy:

Resistance thermometer

| | |
|-------------------------------|---|
| Range: | 0-400Ω (-200°C to +850°C) |
| Resistance thermometer types: | 3-wire Pt100 DIN 43760 |
| Resolution (°C): | <±0.08°C with 1.6sec filter |
| Effective resolution: | 13.7 bits |
| Linearity error: | <0.033% (best fit straight line) |
| Calibration error: | <±(0.4°C + 0.15% of reading in °C) |
| Drift with temperature: | <±(0.015°C + 0.005% of reading in °C) per °C |
| Common mode rejection: | <0.00085°C/V (maximum of 264Vrms) |
| Series mode rejection: | <0.240°C/V (maximum of 280mV pk-pk) |
| Lead resistance: | 0Ω to 22Ω, matched lead resistance |
| Input impedance: | 100MΩ |
| Bulb current: | 300µA |

100mV range

| | |
|-------------------------|---------------------------------------|
| Range: | -100mV to +100mV |
| Resolution (µV): | <3.3µV with 1.6s filter time |
| Effective resolution: | 15.9 bits |
| Linearity error: | <0.033% (best fit straight line) |
| Calibration error: | <±10µV, ± 0.2% of measurement at 25°C |
| Drift with temperature: | <±0.2µV + 0.004% of reading per °C |
| Common mode rejection: | >146dB (maximum of 264Vrms) |
| Series mode rejection: | >90dB (maximum of 280mV pk-pk) |
| Input impedance: | >100MΩ |

10 Volts range

| | |
|-------------------------|------------------------------------|
| Range: | 0V to +10.0V |
| Resolution (µV): | <300µV with 1.6sec filter |
| Effective resolution: | 15.4 bits |
| Linearity error: | <0.033% (best fit straight line) |
| Calibration error: | <±(0.4°C + 0.15% of reading in °C) |
| Drift with temperature: | <± 0.1mV + 0.02% of reading per °C |
| Common mode rejection: | >145dB (maximum of 264Vrms) |
| Series mode rejection: | >92dB (maximum of 5V pk-pk) |
| Input impedance: | >69kΩ |

Notes

- (1) Calibration accuracy quoted over full ambient operating range and for all input linearisation types
- (2) Contact Eurotherm for details of availability of custom downloads for alternative sensors

Digital input (LA and LB)

| | |
|------------|---|
| Isolation: | Not isolated from each other. 264Vac double insulation from the PSU and communication |
|------------|---|

Input

| | |
|------------|---|
| Rating | Voltage level: Closed 0 to <11Vdc Open >13 to 24Vdc |
| | Contact closure: Open >28kΩ Closed <100Ω |
| Functions: | Includes program control, alarm acknowledge, SP2 select, manual, keylock, RSP select, standby |

AA Relay

| | |
|------------|---|
| Type: | Form C (changeover) |
| Rating: | Min 1mA @ 1Vdc, Max 2A @ 264Vac resistive 1,000,000 operations with external snubber |
| Isolation: | 264Vac double insulation |
| Functions: | Alarms, events, status |

DC Input module (Isolated)

| | |
|-----------------------|--|
| Calibration accuracy: | <±0.2% of reading ±1LSD |
| Sample rate: | 9Hz (110ms) |
| Isolation: | 264Vac double insulation |
| Input filter: | Off to 999.9. Default 1.6s |
| Zero offset: | User adjustable over full range |
| User calibration: | 2-point gain & offset |
| Functions: | Includes process input, remote setpoint, power limit |

Thermocouple

| | |
|-----------------------------|--|
| Range: | -100mV to +100mV |
| Types: | K, J, N, R, S, B, L, T, C, PL2, custom |
| Resolution (µV): | <3.3µV @ 1.6s filter time |
| Effective resolution: | 15.9 bits |
| Linearisation accuracy: | <0.2% of reading |
| Cold junction compensation: | >30:1 rejection of ambient change External reference of 0°C, 45°C and 50°C <±1°C at 25°C ambient |

Cold junction accuracy:

Resistance thermometer

| | |
|-------------------------------|---|
| Range: | 0-400Ω (-200°C to +850°C) |
| Resistance thermometer types: | 3-wire Pt100 DIN 43760 |
| Resolution (°C): | <±0.08°C with 1.6sec filter |
| Effective resolution: | 13.7 bits |
| Linearity error: | <0.033% (best fit straight line) |
| Calibration error: | <±(0.4°C + 0.15% of reading in °C) |
| Drift with temperature: | <±(0.015°C + 0.005% of reading in °C) per °C |
| Common mode rejection: | <0.00085°C/V (maximum of 264Vrms) |
| Series mode rejection: | <0.240°C/V (maximum of 280mV pk-pk) |
| Lead resistance: | 0Ω to 22Ω, matched lead resistance |
| Input impedance: | 100MΩ |
| Bulb current: | 300µA |

100mV range

| | |
|-------------------------|---------------------------------------|
| Range: | -100mV to +100mV |
| Resolution (µV): | <3.3µV with 1.6s filter time |
| Effective resolution: | 15.9 bits |
| Linearity error: | <0.033% (best fit straight line) |
| Calibration error: | <±10µV, ± 0.2% of measurement at 25°C |
| Drift with temperature: | <±0.2µV + 0.004% of reading per °C |
| Common mode rejection: | >146dB (maximum of 264Vrms) |
| Series mode rejection: | >90dB (maximum of 280mV pk-pk) |
| Input impedance: | >100MΩ |

10 Volts range

| | |
|-------------------------|------------------------------------|
| Range: | -3.0V to +10.0V |
| Resolution (µV): | <300µV with 1.6sec filter |
| Effective resolution: | 15.4 bits |
| Linearity error: | <0.033% (best fit straight line) |
| Calibration error: | <±(0.4°C + 0.15% of reading in °C) |
| Drift with temperature: | <± 0.1mV + 0.02% of reading per °C |
| Common mode rejection: | >145dB (maximum of 264Vrms) |
| Series mode rejection: | >92dB (maximum of 5V pk-pk) |
| Input impedance: | >69kΩ |

Potentiometer input

| | |
|-------------|---|
| Type: | Single channel |
| Resistance: | 100Ω to 15kΩ |
| Excitation: | 0.5Vdc supplied by module |
| Isolation: | 264Vac double insulation |
| Functions: | Includes valve position and remote setpoint |

Analogue control output

| | |
|-------------|-------------------------------|
| Type: | Single channel |
| Rating: | 0-20mA <600Ω 0-10Vdc >500Ω |
| Accuracy: | ±2.5% |
| Resolution: | 10 bits |
| Isolation: | 264Vac double insulation |

Analogue retransmission output

| | |
|-------------|-------------------------------|
| Type: | Single channel |
| Rating: | 0-20mA <600Ω 0-10Vdc >500Ω |
| Accuracy: | ±0.5% |
| Resolution: | 11 bits |
| Isolation: | 264Vac double insulation |

Logic input modules

Module types: Triple contact closure, triple logic level
 Isolation: No channel isolation. 264Vac double insulation from other modules and system
 Rating: Voltage Level: Open -3 to 5Vdc @ <-0.4mA
 Closed 10.8 to 30Vdc @ 2.5mA
 Contact closure: Open >28kΩ
 Closed <100Ω
 Functions: Includes program control, alarm acknowledge, SP2 select, manual, keylock, RSP select, standby

Logic output modules

Module types: Single channel, triple channel
 Isolation: No channel isolation. 264Vac double insulation from other modules and system
 Rating: Single: 12Vdc @ 24mA, source
 Triple: 12Vdc @ 9mA, source
 Functions: Includes control outputs, alarms, events, status

Relay modules

Module types: Single channel Form A, Single channel Form C, dual channel Form A
 Isolation: 264Vac double insulation
 Rating: Min 100mA @ 12Vdc, Max 2A @ 264Vac resistive
 Min 400,000 (max load) operations with external snubber
 Functions: Includes control outputs, alarms, events, status

Triac modules

Module types: Single channel, dual channel
 Isolation: 264Vac double insulation
 Rating: <1A @ 30-264Vac resistive
 Functions: Includes control outputs, alarms, events, status

Transmitter PSU module

Type: Single channel
 Isolation: 264Vac double insulation
 Rating: 24Vdc @ 20mA

Transducer PSU module

Type: Single channel
 Isolation: 264Vac double insulation
 Bridge voltage: Software selectable 5Vdc or 10Vdc
 Bridge resistance: 300Ω to 15kΩ
 Internal shunt resistor: 30.1Ω @0.25%, used for calibration of 350Ω bridge at 80%


Software features

Control loop
 Control types: PID, OnOff, VP, Dual VP
 Cooling types: Linear, fan, oil, water
 Modes: Auto, manual, forced manual
 Overshoot inhibition: High and low cutbacks
 Number of PID sets: 2, selectable on PV
 Control options: Supply voltage compensation, feedforward, output tracking, OP power limiting, SBR safe output
 Setpoint options: Remote SP with trim, SP rate limit, 2nd Setpoint, tracking modes

Setpoint programmer
 Program function: Standard 1, 8 segment
 Optional 1, 4 or 20, 16 segment
 8 with 16 segment programmer
 Ramp rate, Ramp time, dwell, call, step
 Run, Hold, Reset, RunHold, RunReset, ResetRun, Adv Seg, Skip Seg
 Process value, setpoint
 Continue, ramp, reset
 Holdback, inputs

Process alarms
 Number: 4
 Type: High, low, devhi, devlo, devband
 Latching: None, auto, manual, event
 Other features: Blocking


Isolation diagram

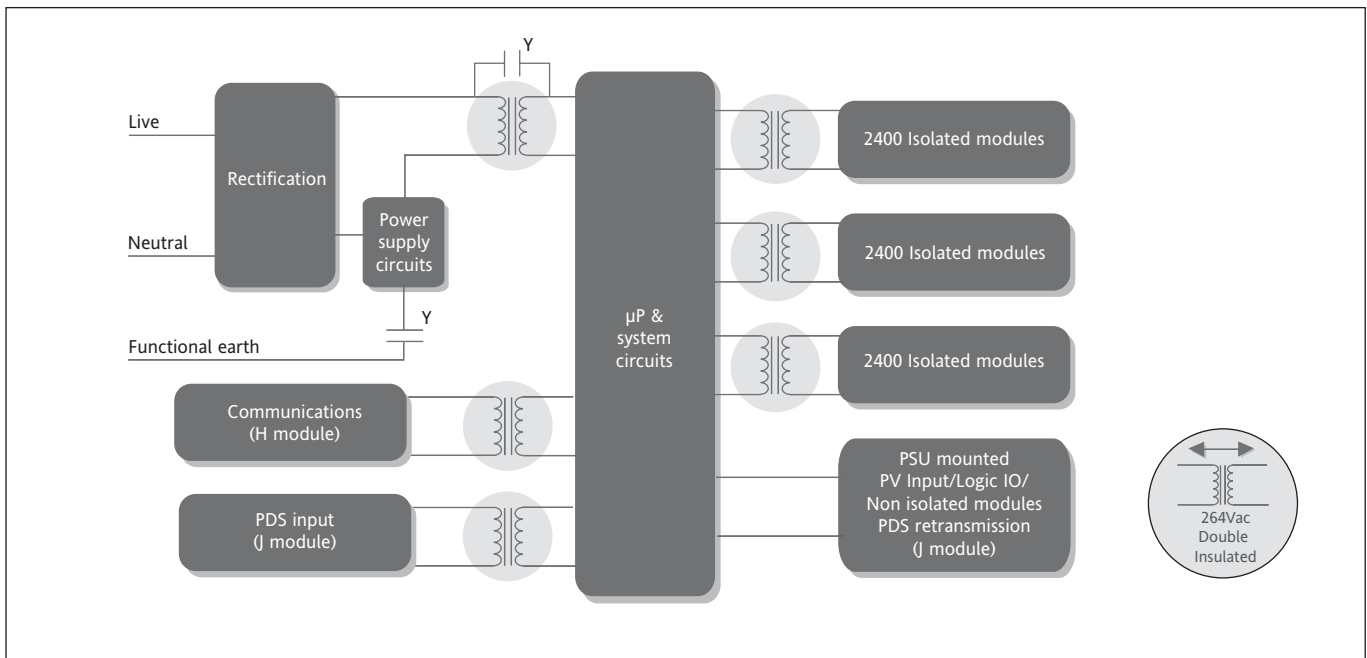

PDSIO load diagnostics

PDSIO (Pulse Density Signalling I/O) is a major innovation in the 2404/2408. When used in combination with a Eurotherm TE10 solid state relay (SSR), it allows the logic output of a 2404/2408 to transmit the power demand signal and simultaneously read back load fault alarms. These alarms will be flashed as messages on the controller front panel.


Two alarm conditions will be detected, either SSR failure indicating an open or short circuit condition in the SSR and heater circuit failure indicating either fuse failure, heater open circuit or line supply absent.

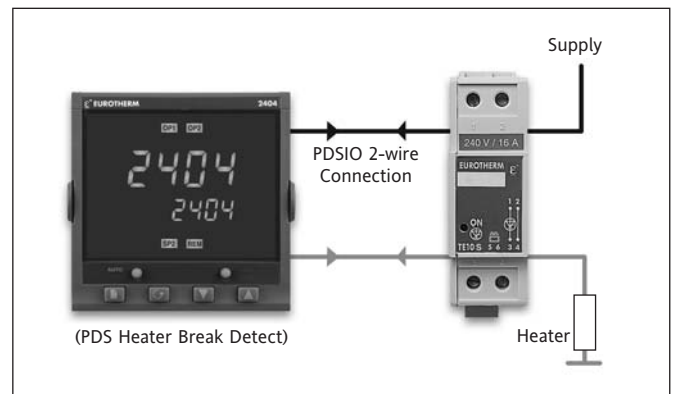

PDSIO master setpoint transmission


PDSIO can be used to digitally transmit the setpoint profile to a number of slave Series 2000 controllers.

If any slave zone departs from the required setpoint by more than a pre-settable amount, a signal from any slave can be transmitted back to the master causing the program to freeze until the error is corrected. Digital accuracy is preserved using PDSIO.


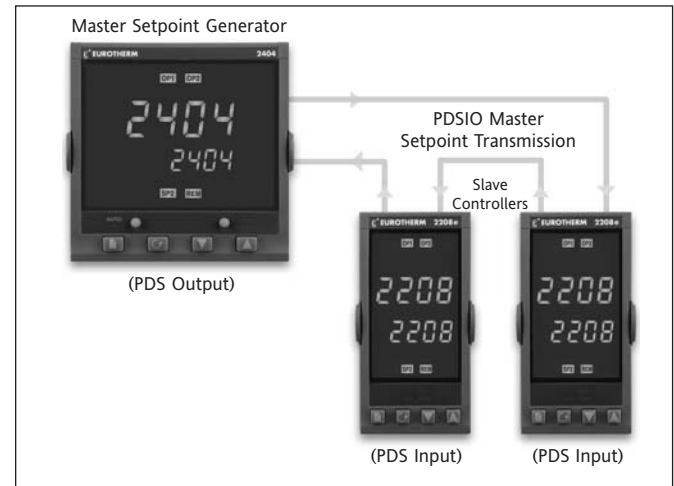


Rear terminal connections

2408

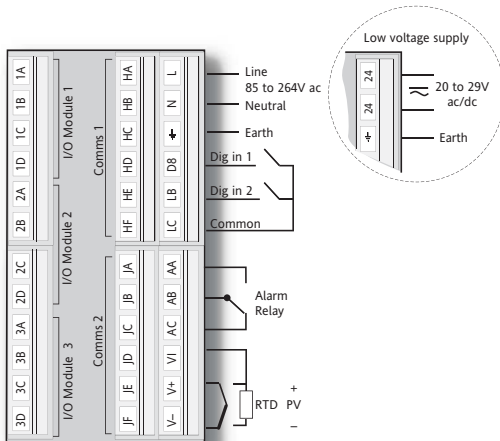

2404

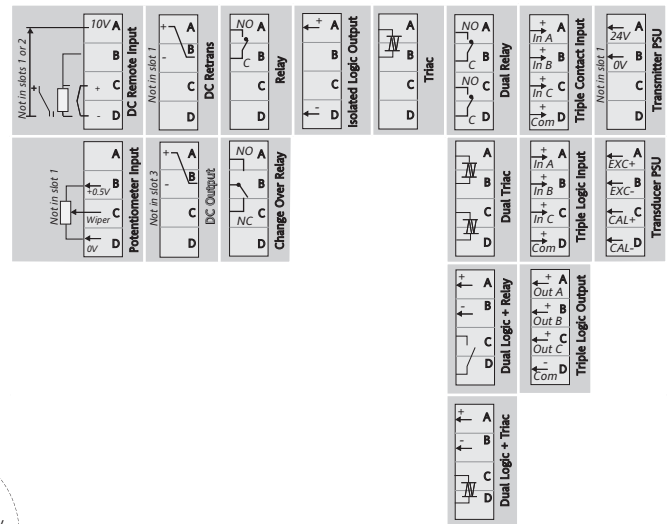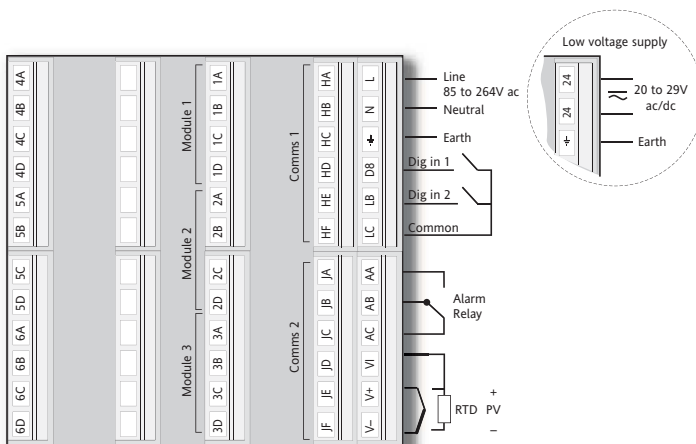

Hardware coding

| Model Number | Function | Supply Voltage | Module 1 | Module 2 | Module 3 | Alarm Relay | 10amp Output | Comms 1 | Comms 2 | Manual |
|--------------|----------|----------------|----------|----------|----------|-------------|------------------|---------|---------|--------|
| | | | | | | | Omit for 2408 | | | |

2408

2404

| Model Number | |
|-----------------------|---------|
| 2408 | 48x96mm |
| 2404 | 96x96mm |
| Profibus units | |
| 2408f | 48x96mm |
| 2404f | 96x96mm |

| Function (2408) | |
|--------------------------------|-------------------------|
| PID control | |
| CC | Controller only |
| CG | 1x 8 seg Prog |
| CP | 1x16 seg Prog |
| P4 | 4x16 seg Prog |
| CM | 20x16 seg Prog (note 1) |
| On/Off Control | |
| NF | Controller only |
| NG | 1x8 seg Prog |
| NP | 1x16 seg Prog |
| N4 | 4x16 seg Prog |
| NM | 20x16 seg Prog (note 1) |
| Motorised valve control | |
| VC | Valve positioner |
| VG | 1x8 seg Prog |
| VP | 1x16 seg Prog |
| V4 | 4x16 seg Prog |
| VM | 20x16 seg Prog (note 1) |

| Function (2404) | |
|--------------------------------|-------------------------|
| PID control | |
| CC | Controller only |
| CG | 1x 8 seg Prog |
| CP | 1x16 seg Prog |
| P4 | 4x16 seg Prog |
| CM | 20x16 seg Prog (note 1) |
| On/Off Control | |
| NF | Controller only |
| NG | 1x8 seg Prog |
| NP | 1x16 seg Prog |
| N4 | 4x16 seg Prog |
| NM | 20x16 seg Prog (note 1) |
| Motorised valve control | |
| VC | Valve positioner |
| VG | 1x 8 seg Prog |
| VP | 1x16 seg Prog |
| V4 | 4x16 seg Prog |
| VM | 20x16 seg Prog (note 1) |

| Supply Voltage | |
|----------------|-------------|
| VH | 85-264Vac |
| VL | 20-29Vac/dc |

| Module 1 | |
|---------------------------------|----------------------------------|
| XX | Not fitted |
| Relay: 2-pin | |
| R2 | Fitted unconfigured |
| RH | Heating output |
| RU | Valve raise output |
| Relay: change over | |
| R4 | Fitted unconfigured |
| YH | Heating output |
| RP | Valve raise (note 6) |
| <i>Or alarm 1 from table A</i> | |
| Logic: (Non-isolated) | |
| L2 | Fitted unconfigured |
| LH | Heating output |
| M1 | PDS Heater break detect (note 2) |
| M2 | PDS Current monitoring (note 3) |
| Logic: (Isolated) | |
| LO | Single logic OP |
| Triac | |
| T2 | Fitted unconfigured |
| TH | Heating output |
| TU | Valve raise output |
| DC control (Isolated) | |
| D4 | Fitted unconfigured |
| H6 | 0-20mA heating |
| H7 | 4-20mA heating |
| H8 | 0-5V heating |
| H9 | 1-5V heating |
| HZ | 0-10V heating |
| Digital I/O (unconfig'd) | |
| TK | Triple contact input |
| TL | Triple logic input |
| TP | Triple logic output |
| Dual relay | |
| RR | Fitted unconfigured |
| RD | Heat + cool |
| RM | VP raise & lower OPs |
| Dual triac | |
| TT | Fitted unconfigured |
| TD | Heat + cool |
| TM | VP raise & lower OPs |
| Logic+relay | |
| LR | Fitted unconfigured |
| LD | Heat + cool |
| QC | Mode 2 + cool |
| Logic+triac | |
| LT | Fitted unconfigured |
| GD | Heat + cool |
| QD | Mode 2 + cool |
| Transducer PS | |
| G3 | 5Vdc transducer PSU |
| G5 | 10Vdc transducer PSU |
| Table A: alarm codes | |
| FH | High alarm |
| FL | Low alarm |
| DB | Dev. band alarm |
| DL | Dev. low alarm |
| DH | Dev. high alarm |

| Module 2 | |
|-----------------------------------|-------------------------------|
| XX | Not fitted |
| Relay: 2-pin | |
| R2 | Fitted unconfigured |
| RC | Cooling output |
| RW | Valve lower output |
| Relay: change over | |
| R4 | Fitted unconfigured |
| YC | Cooling output |
| RL | Valve lower (note 6) |
| PO | Program event 1 (note 7) |
| PE | Program END output |
| <i>Or alarm 2 from table A</i> | |
| Dual relay | |
| RR | Fitted unconfigured |
| PP | Program events 1 & 2 (note 7) |
| Logic: (Non-isolated) | |
| L2 | Fitted unconfigured |
| LC | Cooling output |
| Logic: (Isolated) | |
| LO | Single logic OP |
| Triac | |
| T2 | Fitted unconfigured |
| TC | Cooling output |
| TW | Valve lower output |
| DC control (Isolated) | |
| D4 | Fitted unconfigured |
| C6 | 0-20mA cooling |
| C7 | 4-20mA cooling |
| C8 | 0-5V cooling |
| C9 | 1-5V cooling |
| CZ | 0-10V cooling |
| Digital I/O (unconfig'd) | |
| TK | Triple contact input |
| TL | Triple logic input |
| TP | Triple logic output |
| Power supply | |
| MS | 24Vdc transmitter |
| DC retrans. (Isolated) | |
| <i>Select from Table B</i> | |
| Potentiometer input | |
| VU | Fitted unconfigured |
| VS | Valve position feedback |
| VR | Setpoint input |
| Transducer PS | |
| G3 | 5Vdc transducer PSU |
| G5 | 10Vdc transducer PSU |
| Table B: DC retransmission | |
| D6 Fitted unconfigured | |
| First character | |
| V- | PV retrans |
| S- | Setpoint retrans |
| O- | Output retrans |
| Z- | Error retrans |
| Second character | |
| -1 | 0-20mA |
| -2 | 4-20mA |
| -3 | 0-5V |
| -4 | 1-5V |
| -5 | 0-10V |

| Module 3 | |
|---------------------------------|------------------------------|
| XX | Not fitted |
| Relay: 2-pin | |
| R2 | Fitted unconfigured |
| Relay: change over | |
| R4 | Fitted unconfigured |
| PO | Program event 4 (note 7) |
| PE | Program END output |
| <i>Or alarm 3 from table A</i> | |
| Logic: (Non-isolated) | |
| L2 | Fitted unconfigured |
| LO | Single logic OP |
| Triac | |
| T2 | Fitted unconfigured |
| Dual relay | |
| RR | Fitted unconfigured |
| PP | Program event 4 & 5 (note 7) |
| Digital I/O (unconfig'd) | |
| TK | Triple contact input |
| TL | Triple logic input |
| TP | Triple logic output |
| Power supply | |
| MS | 24Vdc transmitter |
| DC remote input | |
| D5 | Fitted unconfigured |
| W2 | 4-20mA setpoint |
| W5 | 0-10V setpoint |
| WP | Second PV input |
| DC retrans. (Isolated) | |
| <i>Select from Table B</i> | |
| Potentiometer input | |
| VU | Fitted unconfigured |
| VS | Valve position feedback |
| VR | Setpoint input |

| Alarm relay | |
|------------------------------------|---------------------------------|
| XX | Not fitted |
| Alarm 4 relay | |
| RF | Fitted unconfigured |
| <i>Table A alarm options plus:</i> | |
| RA | Rate of change alarm |
| <i>PDS Alarms</i> | |
| LF | Heater break detect |
| HF | Current monitoring heater break |
| SF | Current monitoring SSR failure |
| PO | Program event 7 (note 7) |
| PE | Program END output |

| 10amp Output | |
|--------------|------------|
| XX | Not fitted |


| Comms 1 | |
|------------------------|------------------------------|
| XX | Not fitted |
| 2 wire, EIA485 | |
| Y2 | Fitted unconfigured |
| YM | Modbus protocol |
| YE | El-Bisynch protocol (note 1) |
| EIA232 | |
| A2 | Fitted unconfigured |
| AM | Modbus protocol |
| AE | El-Bisynch protocol (note 1) |
| 4 wire EIA422 | |
| F2 | Fitted unconfigured |
| FM | Modbus protocol |
| FE | El-Bisynch protocol (note 1) |
| PDS Output | |
| M7 | Fitted unconfigured |
| MS | PV retrans |
| TS | Setpoint retrans |
| OT | Output retrans |
| Profibus Module | |
| PB | Profibus (note 6) |
| DeviceNet | |
| DN | DeviceNet |

| Comms 2 | |
|-------------------|---------------------|
| XX | Not fitted |
| PDS Input | |
| M6 | Fitted unconfigured |
| RS | Setpoint input |
| PDS Output | |
| M7 | Fitted unconfigured |
| PT | PV retrans |
| TS | Setpoint retrans |
| OT | Output retrans |

| Manual | |
|--------|-----------|
| XXX | No manual |
| ENG | English |
| FRA | French |
| GER | German |
| NED | Dutch |
| SPA | Spanish |
| SWE | Swedish |
| ITA | Italian |

2404/2408 Accessories

| | |
|--------------------------|--------------|
| Handbook | HA025132 |
| Communications handbook | HA026230 |
| Profibus DP handbook | HA026290 |
| 2.49Ω precision resistor | SUB24/2R49.1 |



| Sensor Input | | Setpoint Min | Setpoint Max |
|--|---|--------------|--------------|
| Standard Sensor Inputs | | | |
| J | J Thermocouple | -210 | 1200 |
| K | K Thermocouple | -200 | 1372 |
| T | T Thermocouple | -200 | 400 |
| L | L Thermocouple | -200 | 900 |
| N | N Thermocouple-Nicrosil/Nisil | -250 | 1300 |
| R | R Thermocouple-Pt/Pt13%Rh | -50 | 1700 |
| S | S Thermocouple-Pt/Pt10%Rh | -50 | 1768 |
| B | B Thermocouple-Pt/Pt30%Rh -6%Rh | 0 | 1820 |
| P | Platinel II Thermocouple | 0 | 1369 |
| Z | RTD/PT100 DIN 43760 | -200 | 850 |
| Factory Downloaded Input | | | |
| C | C Thermocouple - W5%Re/W26%Re (Hoskins) | 0 | 2319 |
| D | D Thermocouple - W3%Re/W25%Re | 0 | 2399 |
| E | E Thermocouple | -250 | 1000 |
| 1 | Ni/Ni18%Mo Thermocouple | 0 | 1399 |
| 2 | Pt20%Rh/Pt40%Rh Thermocouple | 0 | 1870 |
| 3 | W/W26%Re (Engelhard) Thermocouple | 0 | 2000 |
| 4 | W/W26%Re (Hoskins) Thermocouple | 0 | 2010 |
| 5 | W5%Re/W26%Re (Engelhard) Thermocouple | 10 | 2300 |
| 6 | W5%Re/W26%Re (Bucose) Thermocouple | 0 | 2000 |
| 7 | Pt10%Rh/Pt40%Rh Thermocouple | 200 | 1800 |
| 8 | Exergen K80 I.R. pyrometer | -45 | 650 |
| Process Inputs (Scaled to setpoint min and max) | | | |
| F | -100 to +100mV linear | -1999 | 9999 |
| Y | 0 to 20mA linear (note 4) | -1999 | 9999 |
| A | 4 to 20mA linear (note 4) | -1999 | 9999 |
| W | 0 to 5Vdc linear | -1999 | 9999 |
| G | 1 to 5Vdc linear | -1999 | 9999 |
| V | 0 to 10Vdc linear | -1999 | 9999 |

| Display Units | |
|---------------|--------------|
| C | Celsius |
| F | Fahrenheit |
| K | Kelvin |
| X | Linear input |

| Digital Input 1 & 2 | |
|---------------------|--|
| XX | Disabled |
| AM | Manual select |
| SR | Remote SP select |
| S2 | Second setpoint |
| EH | Integral hold |
| AC | Alarm acknowledge |
| RP | SP rate limit enabled |
| RN | Run program |
| HO | Hold program |
| RE | Reset program |
| RH | Run/hold prog |
| KL | Keylock |
| NT | Run/Reset |
| TN | Reset/Run |
| HB | Program holdback |
| P2 | Second PID |
| ST | One shot tune enable |
| AT | Adaptive tune enable |
| FA | Select full access level |
| RB | Simulates UP button |
| LB | Simulates DOWN button |
| SB | Simulates SCROLL button |
| PB | Simulates PAGE button |
| B1 | Least sig. BCD digit |
| B2 | 2nd BCD digit |
| B3 | 3rd BCD digit |
| B4 | 4th BCD digit |
| B5 | 5th BCD digit |
| B6 | Most significant digit |
| SY | Standby-all O/Ps OFF |
| SC | Prog synchronisation |
| SG | Skip segment (without changing SP) |
| PV | Select PV2 |
| AG | Advance to end of segment(& step to target SP) |
| M5 | CTX (mode 5) Input 2 only |

| Options | |
|------------------------------|---|
| Control action | |
| XX | Reverse acting (standard) |
| DP | Direct acting |
| Power feedback | |
| XX | Enabled on logic, relay & triac heating |
| PD | Feedback disabled |
| Cooling options | |
| XX | Linear cooling |
| CF | Fan cooling |
| CW | Water cooling |
| CL | Oil cooling |
| NT | On/Off cooling |
| Front panel buttons | |
| XX | Enabled |
| MD | Auto/manual disabled |
| MR | Auto/man & run/hold disabled |
| RD | Run/hold disabled |
| Programmer time units | |
| XX | Dwell & ramp in mins |
| HD | Dwell time in hours |
| HR | Ramp rate in units/hrs |
| HT | Ramp/dwell hours |

Note 1.
Not available with profibus controllers

Note 2.
PDS heater break detect will transmit the power demand to a TE10S Solid State Relay and read back a heater break alarm.

Note 3.
PDS current monitoring will transmit the power demand signal to a TE10S Solid State Relay and read back load current and open and short circuit alarms.

Note 4.
Setpoint limits: Include the decimal position required in the displayed value. Up to one for temperature inputs, up to two for process inputs.

Note 5.
An external 1% current sense resistor is supplied as standard. If greater accuracy is required, a 0.1% 2.49Ω can be ordered as part no. SUB2K/249R.1.

Note 6.
Only available with Profibus controller.


Note 7.
Not available with 8 segment programmer

Example ordering code

2408 - CC - VH - LH - RC - FL - FH - YM - TS - K - 0 - 1000 - C - AM - S2 - XX - XX - XX - MD - XX

2408, PID Controller, 85 to 264Vac, Logic heating, Relay cooling, Low alarm relay, High alarm relay, RS485, Modbus comms, PDSIO setpoint retrans, Type K thermocouple, 0 to 1000°C, Auto/manual select, 2nd setpoint select, Manual button disabled.

Dimensional details

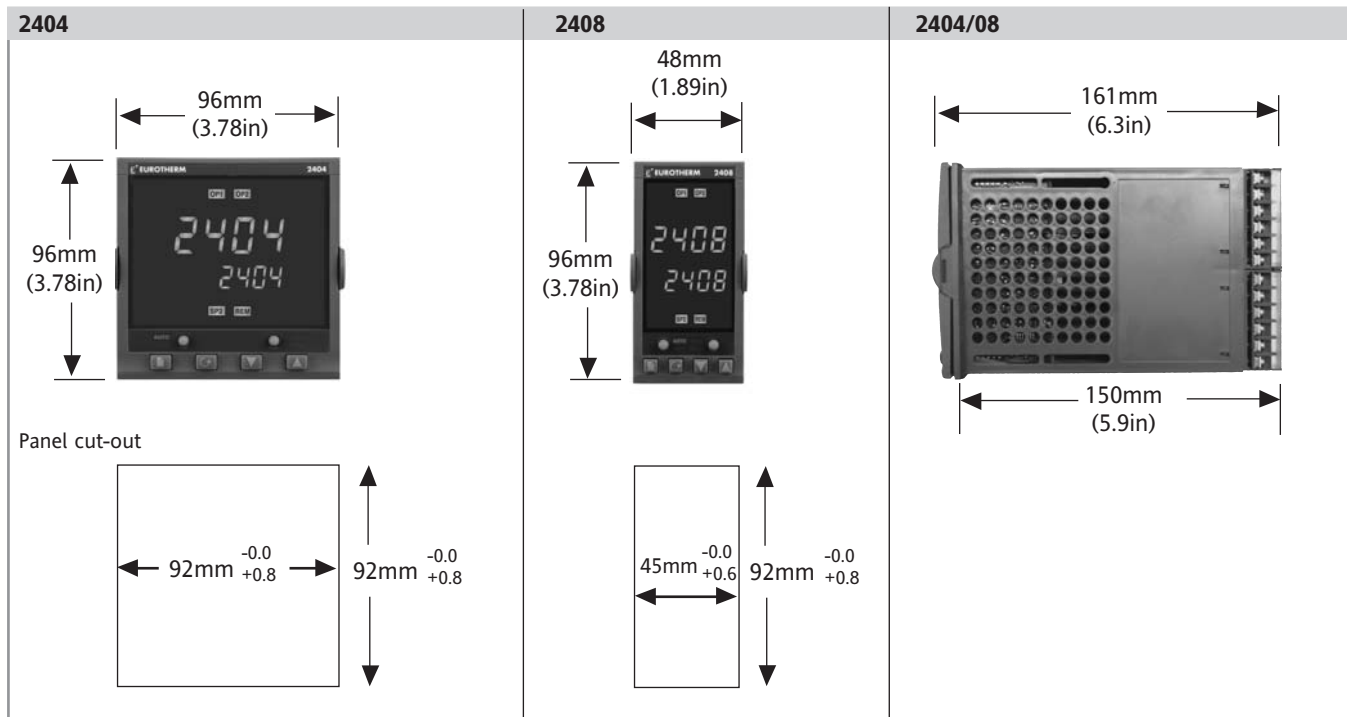

Eurotherm: International sales and service

Understanding and providing local support is a key part of Eurotherm's business. Complementing worldwide Eurotherm offices are a whole range of partners and a comprehensive technical support team... to ensure you get a service you will want to go back to.

AUSTRALIA Sydney
Eurotherm Pty. Ltd.
T (+61 2) 9838 0099
F (+61 2) 9838 9288
E info.au@eurotherm.com

AUSTRIA Vienna
Eurotherm GmbH
T (+43 1) 7987601
F (+43 1) 7987605
E info.at@eurotherm.com

BELGIUM & LUXEMBOURG Moha
Eurotherm S.A/N.V.
T (+32) 85 274080
F (+32) 85 274081
E info.be@eurotherm.com

BRAZIL Campinas-SP
Eurotherm Ltda.
T (+5519) 3707 5333
F (+5519) 3707 5345
E info.br@eurotherm.com

DENMARK Copenhagen
Eurotherm Danmark AS
T (+45 70) 234670
F (+45 70) 234660
E info.dk@eurotherm.com

FINLAND Abo
Eurotherm Finland
T (+358) 22506030
F (+358) 22503201
E info.fi@eurotherm.com

FRANCE Lyon
Eurotherm Automation SA
T (+33 478) 664500
F (+33 478) 352490
E info.fr@eurotherm.com

GERMANY Limburg
Eurotherm Deutschland GmbH
T (+49 6431) 2980
F (+49 6431) 298119
E info.de@eurotherm.com

HONG KONG & CHINA
Eurotherm Limited North Point
T (+85 2) 28733826
F (+85 2) 28700148
E info.hk@eurotherm.com

Guangzhou Office
T (+86 20) 8755 5099
F (+86 20) 8755 5831
E info.cn@eurotherm.com

Beijing Office
T (+86 10) 6567 8506
F (+86 10) 6567 8509
E info.cn@eurotherm.com

Shanghai Office
T (+86 21) 6145 1188
F (+86 21) 6145 1187
E info.cn@eurotherm.com

INDIA Chennai
Eurotherm India Limited
T (+91 44) 24961129
F (+91 44) 24961831
E info.in@eurotherm.com

IRELAND Dublin
Eurotherm Ireland Limited
T (+353 1) 4691800
F (+353 1) 4691300
E info.ie@eurotherm.com

ITALY Como
Eurotherm S.r.l.
T (+39 31) 975111
F (+39 31) 977512
E info.it@eurotherm.com

KOREA Seoul
Eurotherm Korea Limited
T (+82 31) 2738507
F (+82 31) 2738508
E info.kr@eurotherm.com

NETHERLANDS Alphen a/d Rijn
Eurotherm B.V.
T (+31 172) 411752
F (+31 172) 417260
E info.nl@eurotherm.com

NORWAY Oslo
Eurotherm A/S
T (+47 67) 592170
F (+47 67) 118301
E info.no@eurotherm.com

POLAND Katowice
Invensys Eurotherm Sp z o.o.
T (+48 32) 2185100
F (+48 32) 2177171
E info.pl@eurotherm.com

SPAIN Madrid
Eurotherm España SA
T (+34 91) 6616001
F (+34 91) 6619093
E info.es@eurotherm.com

SWEDEN Malmo
Eurotherm AB
T (+46 40) 384500
F (+46 40) 384545
E info.se@eurotherm.com

SWITZERLAND Wollerau
Eurotherm Produkte (Schweiz) AG
T (+41 44) 7871040
F (+41 44) 7871044
E info.ch@eurotherm.com

UNITED KINGDOM Worthing
Eurotherm Limited
T (+44 1903) 268500
F (+44 1903) 265982
E info.uk@eurotherm.com
www.eurotherm.co.uk

U.S.A. Leesburg VA
Eurotherm Inc.
T (+1 703) 443 0000
F (+1 703) 669 1300
E info.us@eurotherm.com
www.eurotherm.com

ED53

© Copyright Eurotherm Limited 2007

Invensys, Eurotherm, the Eurotherm logo, Chessell, EurothermSuite, Mini8, Eycou, Eyriss and Wonderware are trademarks of Invensys plc, its subsidiaries and affiliates. All other brands may be trademarks of their respective owners.

All rights are strictly reserved. No part of this document may be reproduced, modified, or transmitted in any form by any means, nor may it be stored in a retrieval system other than for the purpose to act as an aid in operating the equipment to which the document relates, without the prior written permission of Eurotherm limited.

Eurotherm Limited pursues a policy of continuous development and product improvement. The specifications in this document may therefore be changed without notice. The information in this document is given in good faith, but is intended for guidance only.

Eurotherm Limited will accept no responsibility for any losses arising from errors in this document.

